

GRAVILLON 14/31.5 mm



Péetrographie : CALCAIRE DUR VISEEN
Elaboration : TERTIAIRE

Partie contractuelle

Valeurs spécifiées sur lesquelles le producteur s'engage

Classe granulaire

Norme

Code

14 31.5

Norme NF P 18-545 Article 10

A (01/01/2012)


	0.063	0.5	d/2 7.1	8	10	12.5	d 14	16	20	D/1.4 22.4	25	28	D 31.5	40	45	1.4D 50	63	2D 63	FI
Etendue e	1.5		5				10			30			9		1			0	
Incertitude U	0.3		1				5			12			5		0			0	4
V.S.S.+U	1.8		6				15			82			100		100			100	24.00
V.S.S.	1.5		5				10			70			99		100			100	20.00
V.S.I.	0.0		0				0			40			90		98			100	
V.S.I.-U	0.0		0				0			28			85		98			100	
Ecart-type max	0.45		1.52				3.03			9.09			2.73		0.30			0.00	

Partie informative

Résultats de production

du 09/01/18 au 28/06/18

	0.063	0.5	7.1	8	10	12.5	14	16	20	22.4	25	28	31.5	40	45	50	63	FI
Maximum	1.4	2	4	4	5	7	9	27	56	69	81	94	98	100	100	100	100	14.00
Xf+1.25xEcart-types	1.0	1	2	2	3	5	8	23	52	67	80	90	98	100	100	100	100	
Moyenne Xf	0.7	1	1	1	1	3	5	17	44	59	72	84	95	100	100	100	100	9.14
Xf-1.25xEcart-types	0.4	0	0	0	0	1	2	11	35	51	64	78	92	100	100	100	100	
Minimum	0.4	0	0	0	0	1	2	9	32	46	59	73	90	100	100	100	100	6.00
Ecart-type	0.25	0.4	0.7	0.8	1.0	1.6	2.3	5.0	6.7	6.5	6.3	4.9	2.4	0.0	0.0	0.0	0.0	2.531
Nombre de résultats	44	44	44	44	44	44	44	44	44	44	44	44	44	44	44	44	44	7

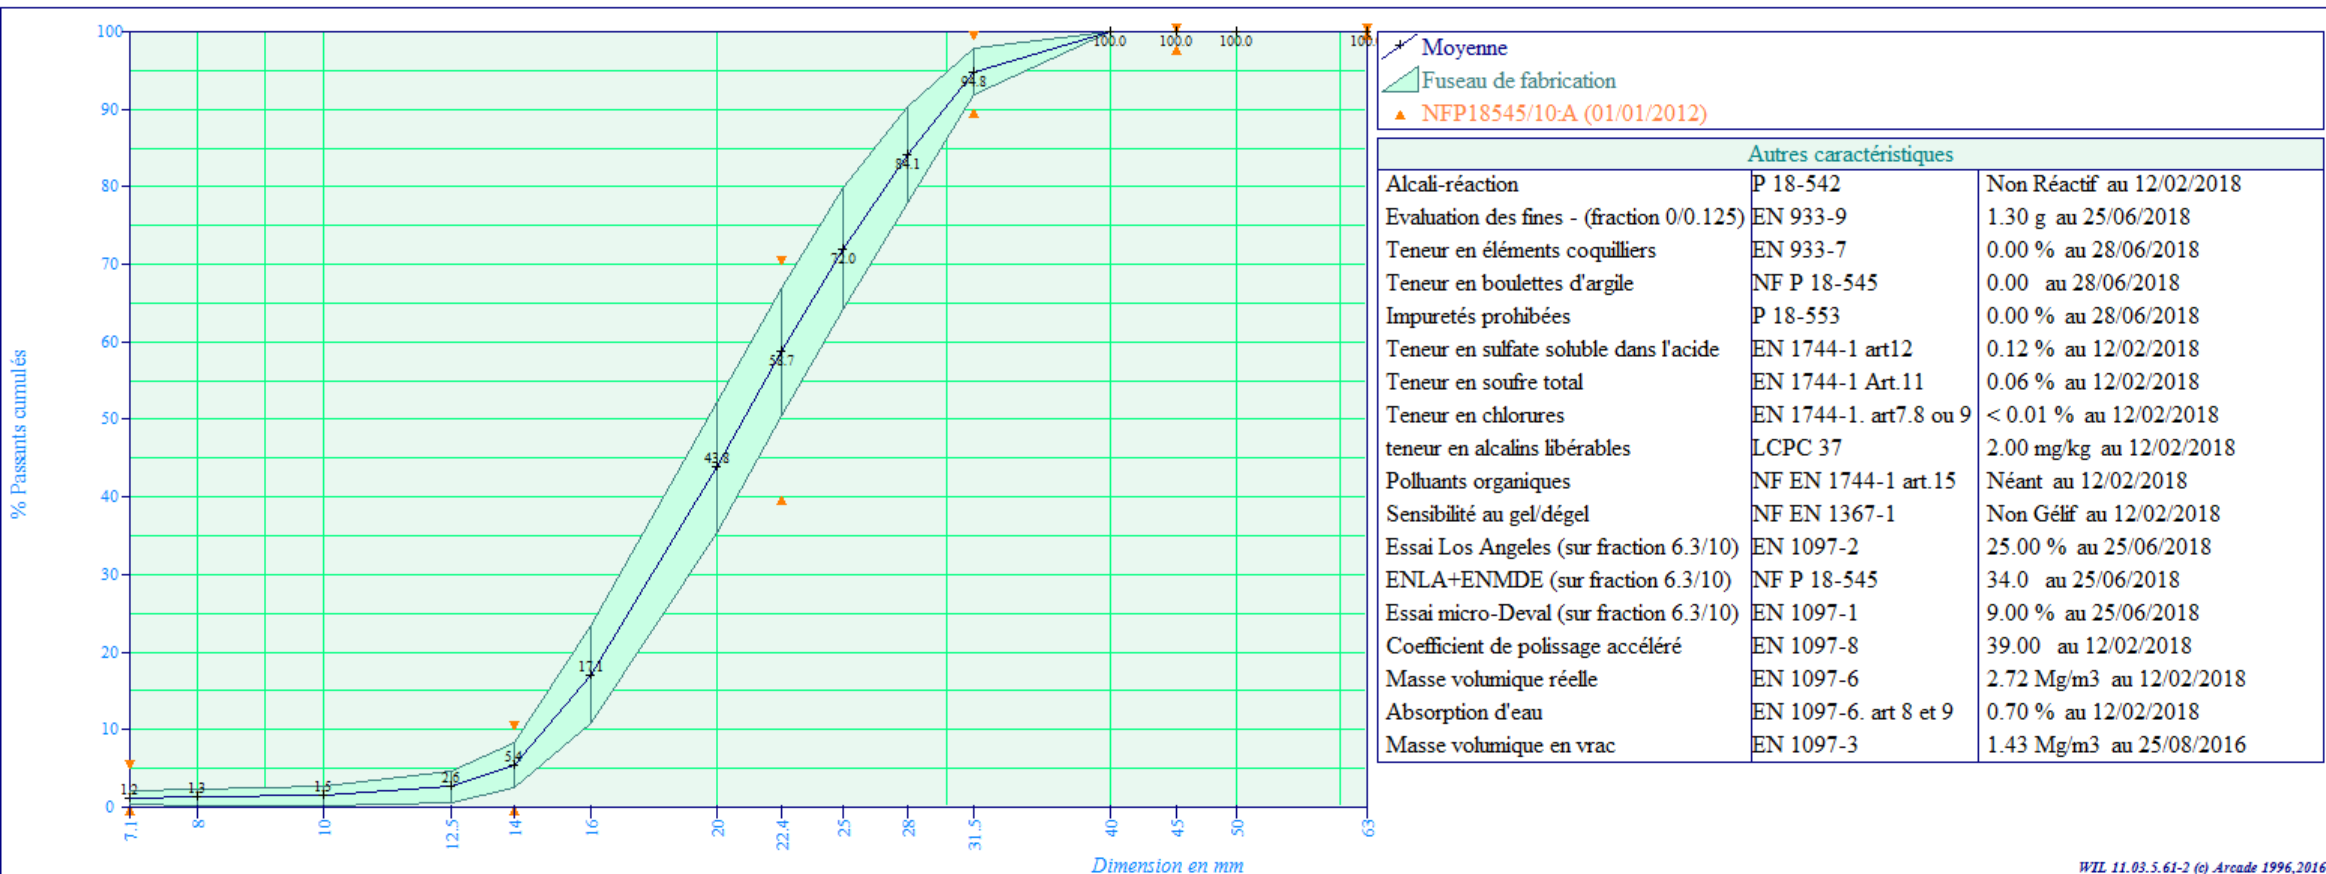

le Responsable Laboratoire

E. COLIN