

GRAVILLON 4/14 mm



Péetrographie : CALCAIRE DUR VISEEN

Partie contractuelle

Valeurs spécifiées sur lesquelles le producteur s'engage

Classe granulaire

Norme

Code

4 14

Norme NF P 18-545 Article 7

C III (01/01/2012)


	0.063	0.5	d/2 2	d 4	6.3	8	D/1.4 10	12.5	D 14	16	1.4D 20	2D 28	FI
Etendue e	2		5	10			30		9		2	0	
Incertitude U	0.3		1	5			6		5		1	0	4
V.S.S.+U	2.3		6	16			76		100		100	100	24.00
V.S.S.	2.0		5	11			70		99		100	100	20.00
V.S.I.	0.0		0	1			40		90		98	100	
V.S.I.-U	0.0		0	0			34		85		97	100	
Ecart-type max	0.61		1.52	3.03			9.09		2.73		0.61	0.00	

Partie informative

Résultats de production

du 23/01/18 au 26/06/18

	0.063	0.5	2	4	6.3	8	10	12.5	14	16	20	28	FI
Maximum	1.7	2	3	7	39	55	69	88	98	100	100	100	18.00
Xf+1.25xEcart-types	1.8	2	3	7	34	51	66	87	96	100	100	100	
Moyenne Xf	1.3	2	2	5	28	45	61	82	93	100	100	100	16.33
Xf-1.25xEcart-types	0.9	1	1	3	22	38	55	76	91	100	100	100	
Minimum	0.8	1	1	3	19	35	51	74	91	99	100	100	13.00
Ecart-type	0.36	0.5	0.8	1.5	5.0	5.3	4.2	4.2	1.8	0.1	0.0	0.0	1.795
Nombre de résultats	15	15	15	15	15	15	15	15	15	15	15	15	6

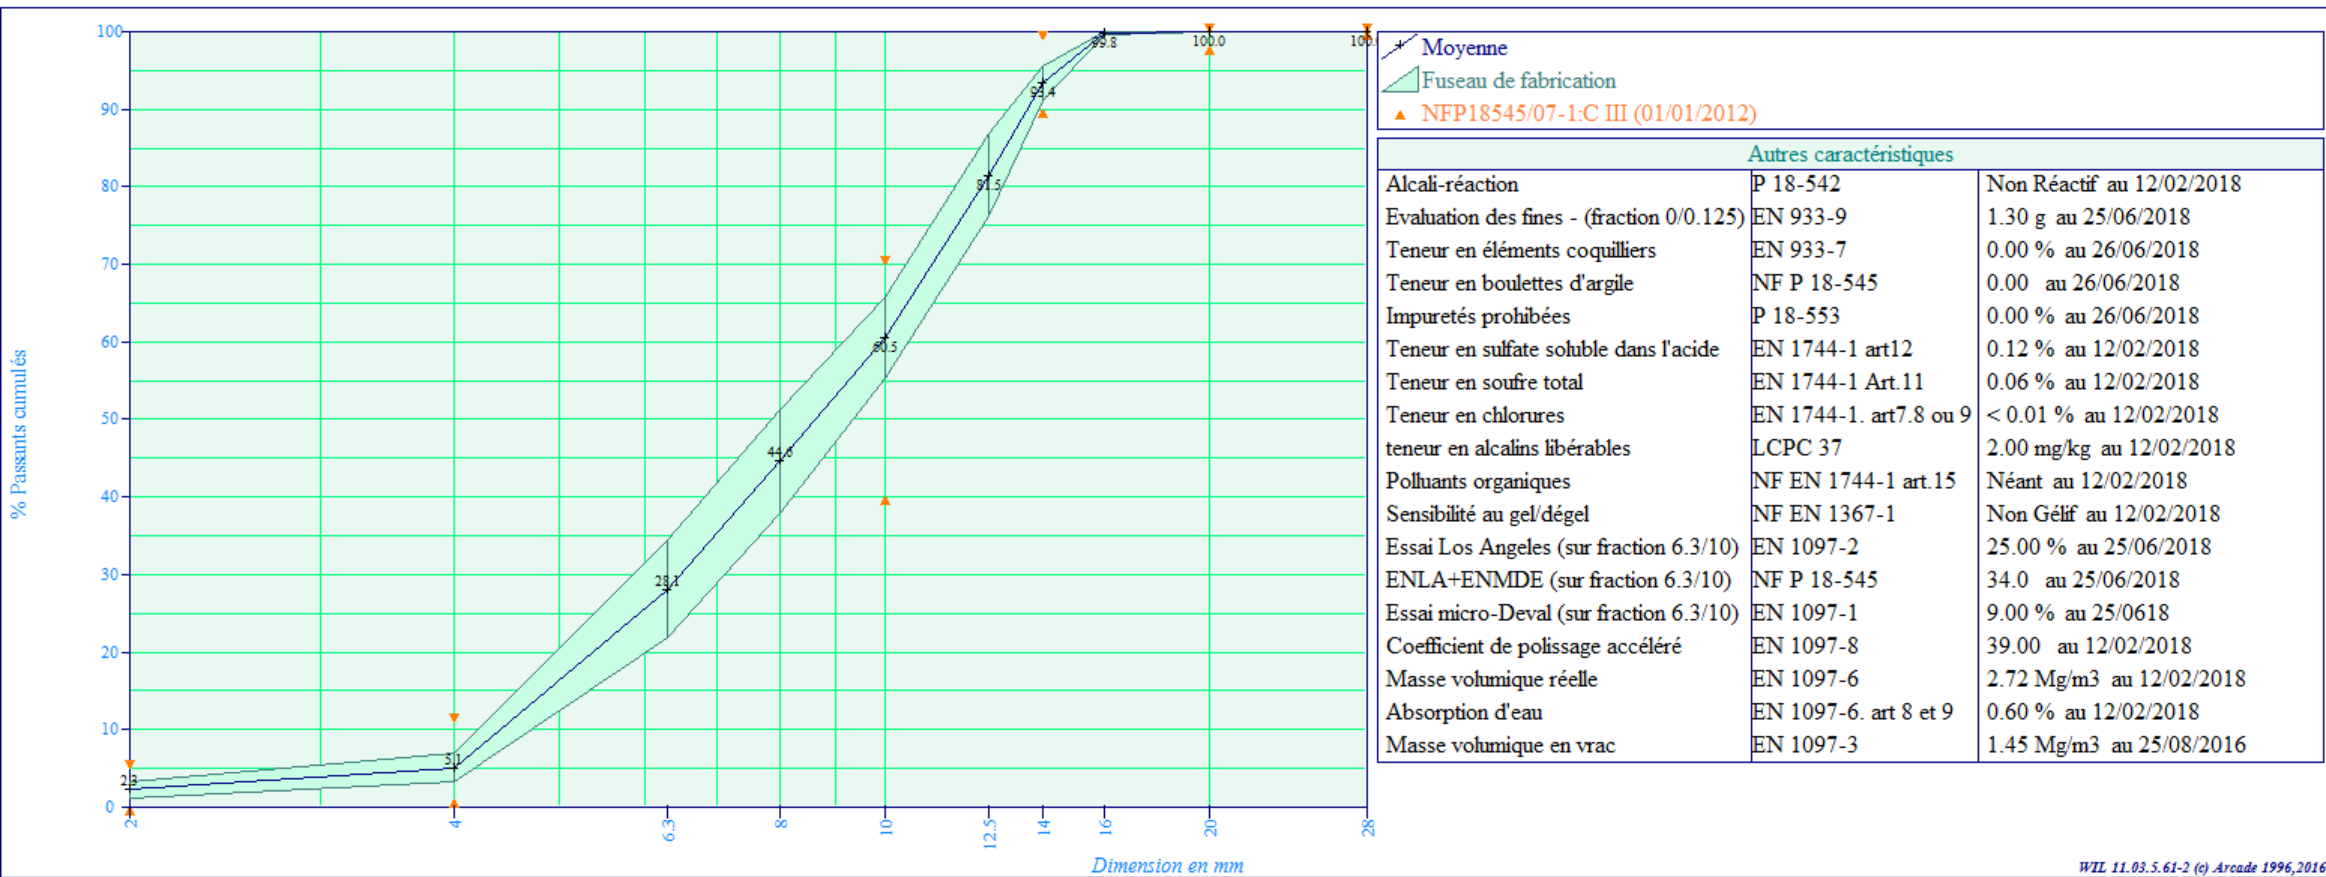

le Responsable Laboratoire

E. COLIN