

GRAVILLON 14/20 mm



Péetrographie : CALCAIRE DUR VISEEN
Elaboration : TERTIAIRE

Partie contractuelle

Valeurs spécifiées sur lesquelles le producteur s'engage

Classe granulaire

Norme

Code

14 20

Norme NF P 18-545 Article 7

C III (01/01/2012)


	0.063	0.5	d/2 7.1	8	10	12.5	d 14	16	D 20	22.4	1.4D 28	31.5	2D 40	FI
Etendue e	2		5				10		10		2		0	
Incertitude U	0.3		1				5		5		1		1	4
V.S.S.+U	2.3		6				22		95		100		100	24.00
V.S.S.	2.0		5				17		90		100		100	20.00
V.S.I.	0.0		0				7		80		98		100	
V.S.I.-U	0.0		0				2		75		97		99	
Ecart-type max	0.61		1.52				3.03		3.03		0.61		0.00	

Partie informative

Résultats de production

du 02/07/18 au 10/12/18

	0.063	0.5	7.1	8	10	12.5	14	16	20	22.4	28	31.5	40	FI
Maximum	1.7	2	5	6	8	11	16	56	90	100	100	100	100	16.00
Xf+1.25xEcart-types	1.4	2	3	3	4	8	16	48	88	99	100	100	100	
Moyenne Xf	1.0	1	2	2	3	6	13	41	85	97	100	100	100	11.67
Xf-1.25xEcart-types	0.7	1	1	1	1	4	10	33	81	96	100	100	100	
Minimum	0.5	1	1	1	1	2	8	28	80	94	100	100	100	8.00
Ecart-type	0.30	0.5	1.0	1.1	1.3	1.7	2.3	5.9	2.9	1.5	0.0	0.0	0.0	2.925
Nombre de résultats	45	45	45	45	45	45	45	45	45	45	45	45	45	6

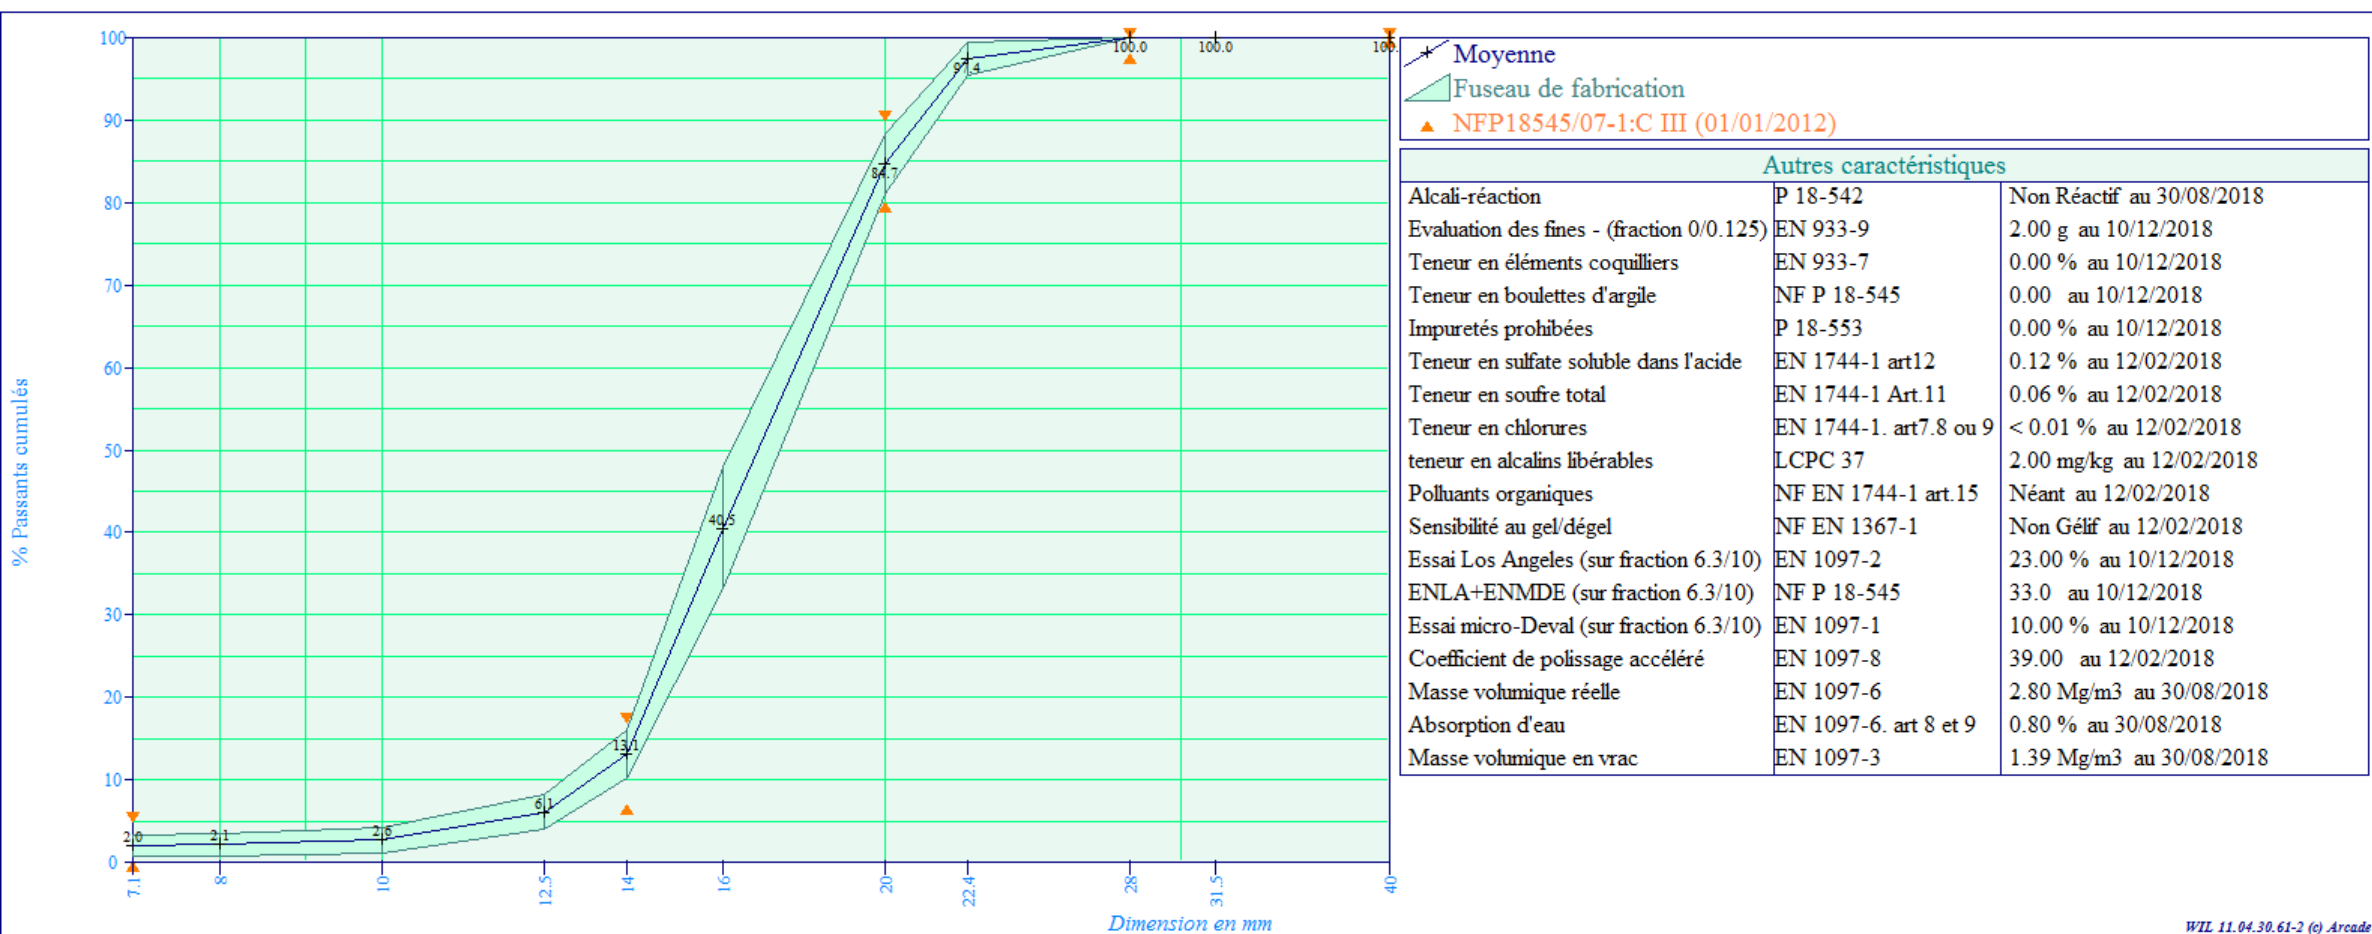

le Responsable Laboratoire

E. COLIN