

GRAVILLON 4/6.3 mm NF



Péetrographie : CALCAIRE DUR VISEEN
Elaboration : TERTIAIRE

Partie contractuelle

Valeurs spécifiées sur lesquelles le producteur s'engage

Classe granulaire

4 6.3

Norme

Norme NF P 18-545 Article 7

Code

C III (01/06/2012)


	0.063	0.5	1	d/2 2	d 4	D 6.3	8	1.4D 9	10	2D 12.5	FI	MBF
Etendue e	2			5	10	10		2		0		10
Incertitude U	0.3			1	5	5		1		0	4	2
V.S.S.+U	2.3			6	20	95		100		100	29.00	12.00
V.S.S.	2.0			5	15	90		100		100	25.00	10.00
V.S.I.	0.0			0	5	80		98		100		
V.S.I.-U	0.0			0	0	75		97		100		
Ecart-type max	0.61			1.52	3.03	3.03		0.61		0.00		

Partie informative

Résultats de production

du 02/07/18 au 10/12/18

	0.063	0.5	1	2	4	6.3	8	9	10	12.5	FI	MBF
Maximum	1.9	3	3	4	14	90	100	100	100	100	22.00	2.70
Xf+1.25xEcart-types	1.7	2	3	3	12	89	100	100	100	100		
Moyenne Xf	1.4	2	2	2	9	85	100	100	100	100	17.17	1.67
Xf-1.25xEcart-types	1.0	1	1	1	5	82	100	100	100	100		
Minimum	0.9	1	1	1	5	81	99	100	100	100	11.00	0.70
Ecart-type	0.32	0.5	0.6	0.9	2.5	2.7	0.2	0.0	0.0	0.0	3.484	0.645
Nombre de résultats	44	44	44	44	44	44	44	44	44	44	6	6

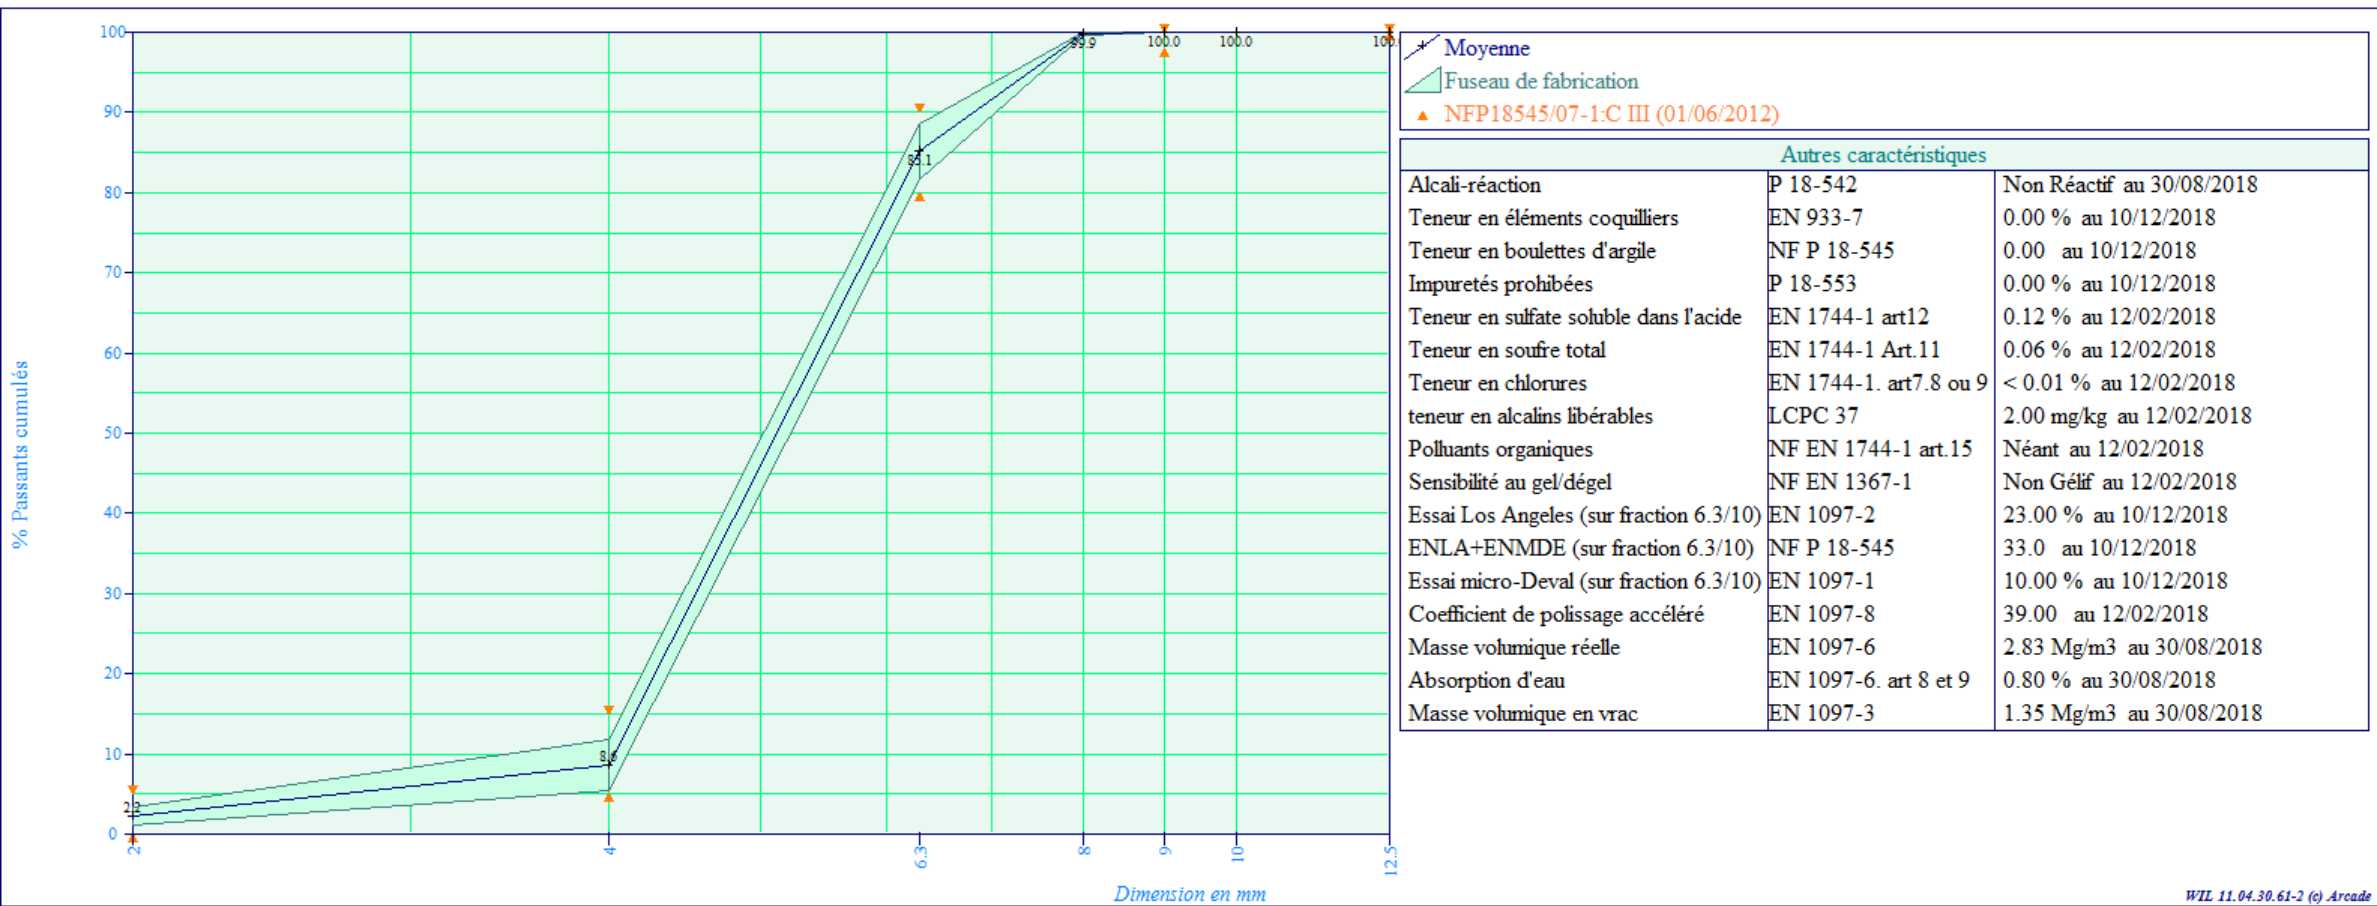

le Responsable Laboratoire

E. COLIN